

PET3CX15000H3


Air Cooled Triode
For Industrial RF Heating

Drop in equivalent of 3CX15000H3

- Output Power: 40 kW
- Anode voltage: 12 kV max
- Anode dissipation: 15 kW max
- Frequency: 90 MHz max

Manufactured in India, in a world-class facility equipped with high quality machinery, materials and components sourced from reputed suppliers in America, Europe and Japan.

Fifty-two weeks warranty against manufacturing defects irrespective of the number of hours of operation.

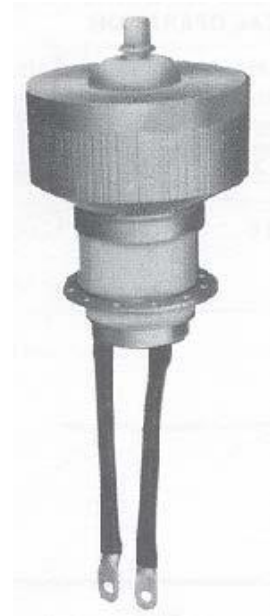

PET3CX15000H3

Forced air-cooled, ceramic-metal power triode with a robust mesh filament, for use in industrial radio-frequency heating.

Electrical Characteristics

Filament							thoriated tungsten
Filament voltage (see note 1)						6.3	V
Filament current						160	A
Surge Filament current (peak) (See note 2).						800	A
Filament cold resistance.						4.7	mΩ
Peak usable cathode current						35	A
Amplification factor ($V_a = 2.3$ kV, $I_a = 1.0$ A)						20	
Mutual conductance ($V_a = 2.5$ kV, $I_a = 1.3$ A).						36	mA/V
Inter – electrode capacitances:							
Grid to anode						39	pF
Grid to filament						58	pF
Anode to filament						1.9	pF

Mechanical Characteristics

Connections							Filament leads and grid contact flange
Operating position							Vertical, either way up
Maximum operating temperature						250	°C
Maximum dimensions							See outline drawings
Net weight							6 kg (13 pounds) approx

Accessories

Cathode connector							CWPA830
-------------------	--	--	--	--	--	--	---------

For frequencies above 2MHz, CWPA830 should be used in conjunction with a strip connection to provide a low inductance cathode return.

Cooling

Sufficient air must be passed through the radiator to keep the temperatures of ceramic to metal seals and of the anode (measured next to the radiator) below the maximum rated value of 250 °C. The air flows required to maintain seal temperature at 225 °C in an ambient temperature of 50 °C and with an operating frequency of less than 30 MHz are shown in the following table.

An additional air flow is required for the filament seals. 16ft³/min directed at the centre contact ring, ½ inch below the outer contact ring, through a 1 ½ inch internal diameter air duct at 45° to the axis of the tube, is sufficient for operation up to 30 MHz at 50 °C ambient and 5000 ft altitude.

Minimum Radiator Air Flow Requirements

Anode Dissipation Watts	Sea Level Pressure		5000 Feet Pressure	
	Air Flow ft ³ /min	Drop inches Water	Air Flow ft ³ /min	Drop inches Water
7500	361	1.63	433	1.96
10 000	606	3.26	728	3.92
15 000	1260	10.0	1510	12.0

The values given allow for maximum filament and grid dissipation in addition to anode dissipation shown.



Radio Frequency Oscillator For Industrial Service

(Class C Conditions, One Tube)

Maximum Ratings (Absolute Values)

Frequency	90	MHz max
Anode voltage	12	kV max
Anode current d.c.(see note 3)	6.0	A max
Anode input power	60	kW max
Anode dissipation	15	kW max
Grid voltage d.c.	1000	V max
Grid current d.c.(see note 4)	1.0	A max
Grid dissipation	500	W max
Cathode current d.c.	7.0	A max

Typical Operating Conditions

Frequency	30	30	MHz
Anode voltage d.c.	7.0	10.0	kV
Anode current d.c.	6.0	5.0	A
Anode dissipation	12	9	kW
Grid voltage d.c.	-600	-800	V
Grid resistor	910	1480	Ω
Grid current d.c..	660	540	mA
Grid dissipation	290	220	W
Drive power	660	650	W
Anode input power	42	50	kW
Anode output power	30	41	kW
Output power less drive	29.3	40.3	kW

Notes

1. The filament voltage measured at the tube should be 6.3 V \pm 5% for satisfactory performance, maximum life is obtained at -5% (6.0 V).
2. The filament current must not exceed 800 A, even momentarily, at any time.
3. Maximum anode voltage and current should not be applied simultaneously; this could result in excessive anode dissipation. The anode supply should include current-limiting resistors, and an over-current trip to remove anode voltage quickly in the event of an overload or arc (such load variations and faults are common in industrial service). Spark gaps should be connected between anode and ground, to protect the tube from voltage transients under fault conditions.
4. The grid current rating of 1.0 A d.c. should not be exceed, except for very short periods during tuning. The grid circuit should include over-current protection, and d.c. grid current should be monitored continuously during industrial operation with varying loads.



Health And Safety Hazards

PET electronic devices are safe to handle and operate, provided that the precautions stated are observed. PET does not accept responsibility for damage or injury resulting from the use of electronic devices it produces. Equipment manufacturers and users must ensure that adequate precautions are taken. Appropriate warning labels and notices must be provided on equipments incorporating PET devices and in operating manuals.



High voltage

Equipment must be designed so that personnel cannot come into contact with high voltage circuits. All high voltage circuits and terminals must be enclosed and fail-safe interlock switches must be fitted to disconnect the primary power supply and discharge all high voltage capacitors and other stored energy before allowing access. Interlock switches must not be bypassed to allow operation with access doors open.



R.F. Radiation

Personnel must not be exposed to excessive r.f. radiation. A properly designed equipment cabinet with good r.f. electrical connection between panels will normally provide sufficient protection.



X-Ray Radiation


This device, when operating at voltages above 5 kV, produces progressively more dangerous X-rays as the voltage is increased, the radiation varies greatly during life. The device envelope provides only limited protection and further shielding may be required. A metal equipment cabinet with overlapping joints will usually provide sufficient shielding, but if there is any doubt an expert in this field should perform an X-ray survey of the equipment.




Implosion

This tube stores potential energy by virtue of its vacuum. The energy level is low, but there is some hazard from flying fragments if the tube is dropped or subjected to violent impact. The tube must be stored and transported in its approved pack. During installation or replacement the tube must not be scratched or damaged in any way likely to reduce the strength of the ceramic envelope.

TYPICAL CONSTANT CURRENT CHARACTERISTICS OF PET3CX15000H3

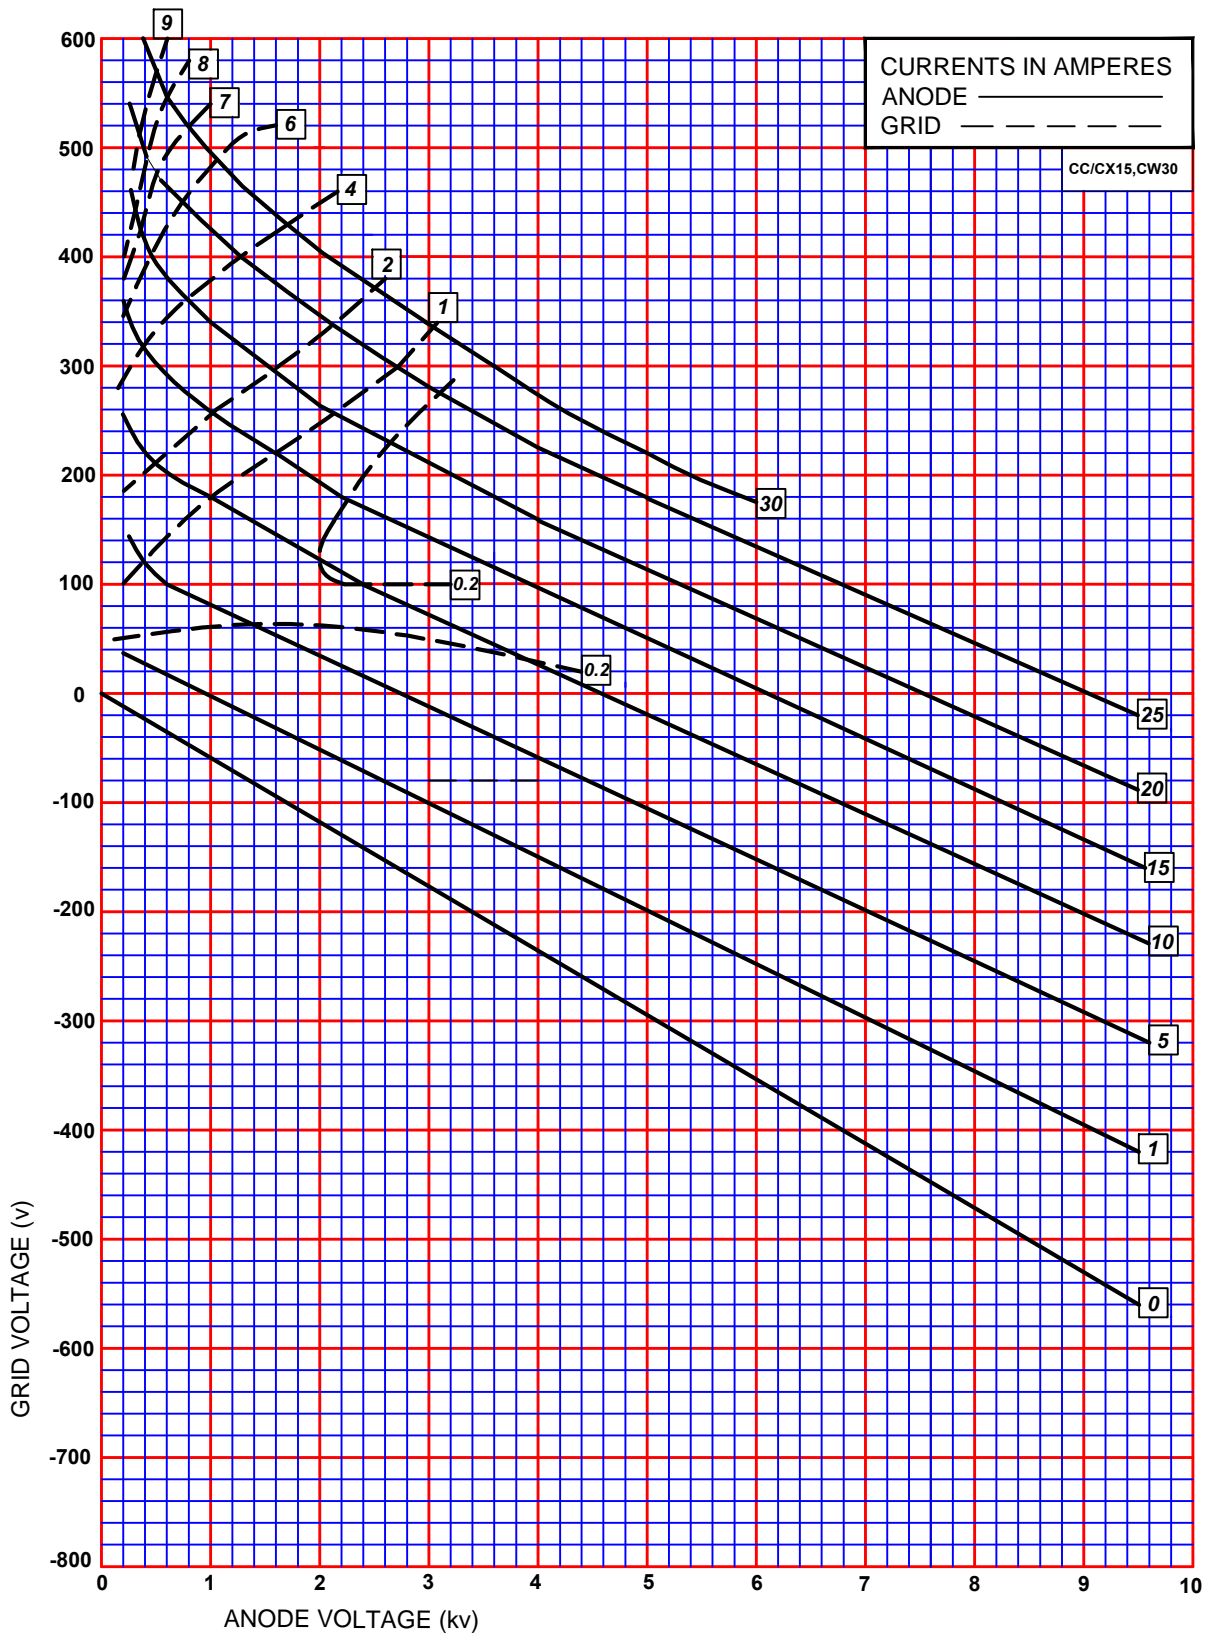

OUTLINE OF PET3CX15000H3

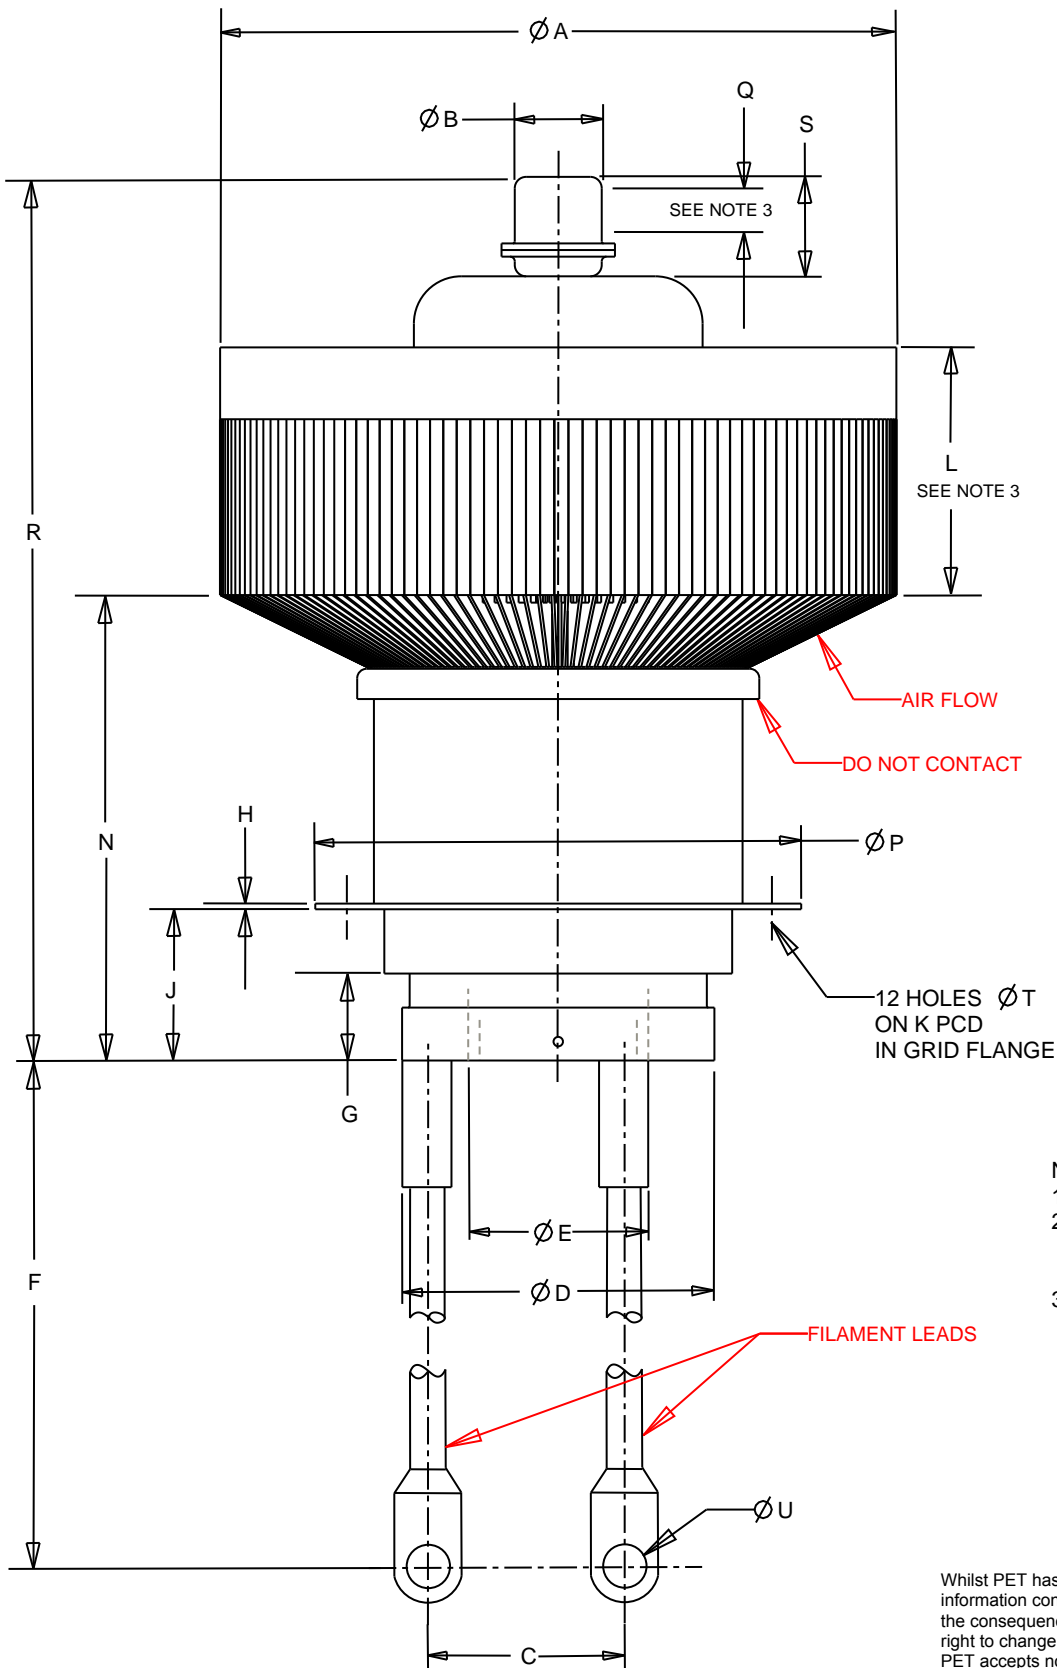

REF.	MILLIMETRES
A	179.10 MAX 176.00 MIN
B	22.50 ±0.50
C	52.04
D	82.60
E	47.63
F	209.55 ±6.35
G	23.00
H	01.50
J	40.00 ±1.0
K	112.65 ±0.25
L	65.50 ±5.0
N	122.5 ±2.5
P	128.52 ±0.76
Q	9.53 MIN
R	236.0 MAX 227.0 MIN
S	26.30
T	06.35
U	9.91

- NOTE:
1. ALL DIMENSIONS ARE IN MM.
 2. GRID FLANGE, FILAMENT CONNECTIONS ORIENTATED AS SHOWN.
 3. ANODE CONNECTION MAY BE MADE TO THIS SURFACE.

Whilst PET has taken care to ensure the accuracy of the information contained herein it accepts no responsibility for the consequences of any use thereof and also reserves the right to change the specifications of goods without notice. PET accepts no liability beyond that set out in its standard conditions of sale in respect of infringement of third party patents arising from the use of tubes or other devices in accordance with information contained herein.